


NOTES:

- 1. Do not install where water levels may rise and contact the unit.
- 2. Do not install within 36in of any door or window.
- 3. Minimum 4 structural fasteners required for wall bracket, corrosion protected steel, diameter 1/4in.
- 4. Fastener head clearance 5/8in tall, 7/8in diameter.
- 5. Use a flat washer between the fastener head and wall bracket if fastener is not a flange head.
- 6. All fasteners must be field supplied.
- 7. Other required clearances shown below.
- 8. All fasteners must engage 1 1/2in with a structural member.
- 9. If mounting into stud framing, the bracket must be fastened to a minimum of two separate structural members
- 10. If mounting to a foundation or masonry, make sure fasteners are clear of any mortar joints.
- 11. If stud is greater than 16in on center, a cross brace must be used.
- 12. Brackets must be level.
- 13. Each horizontal brace requires a minum of two fasteners.

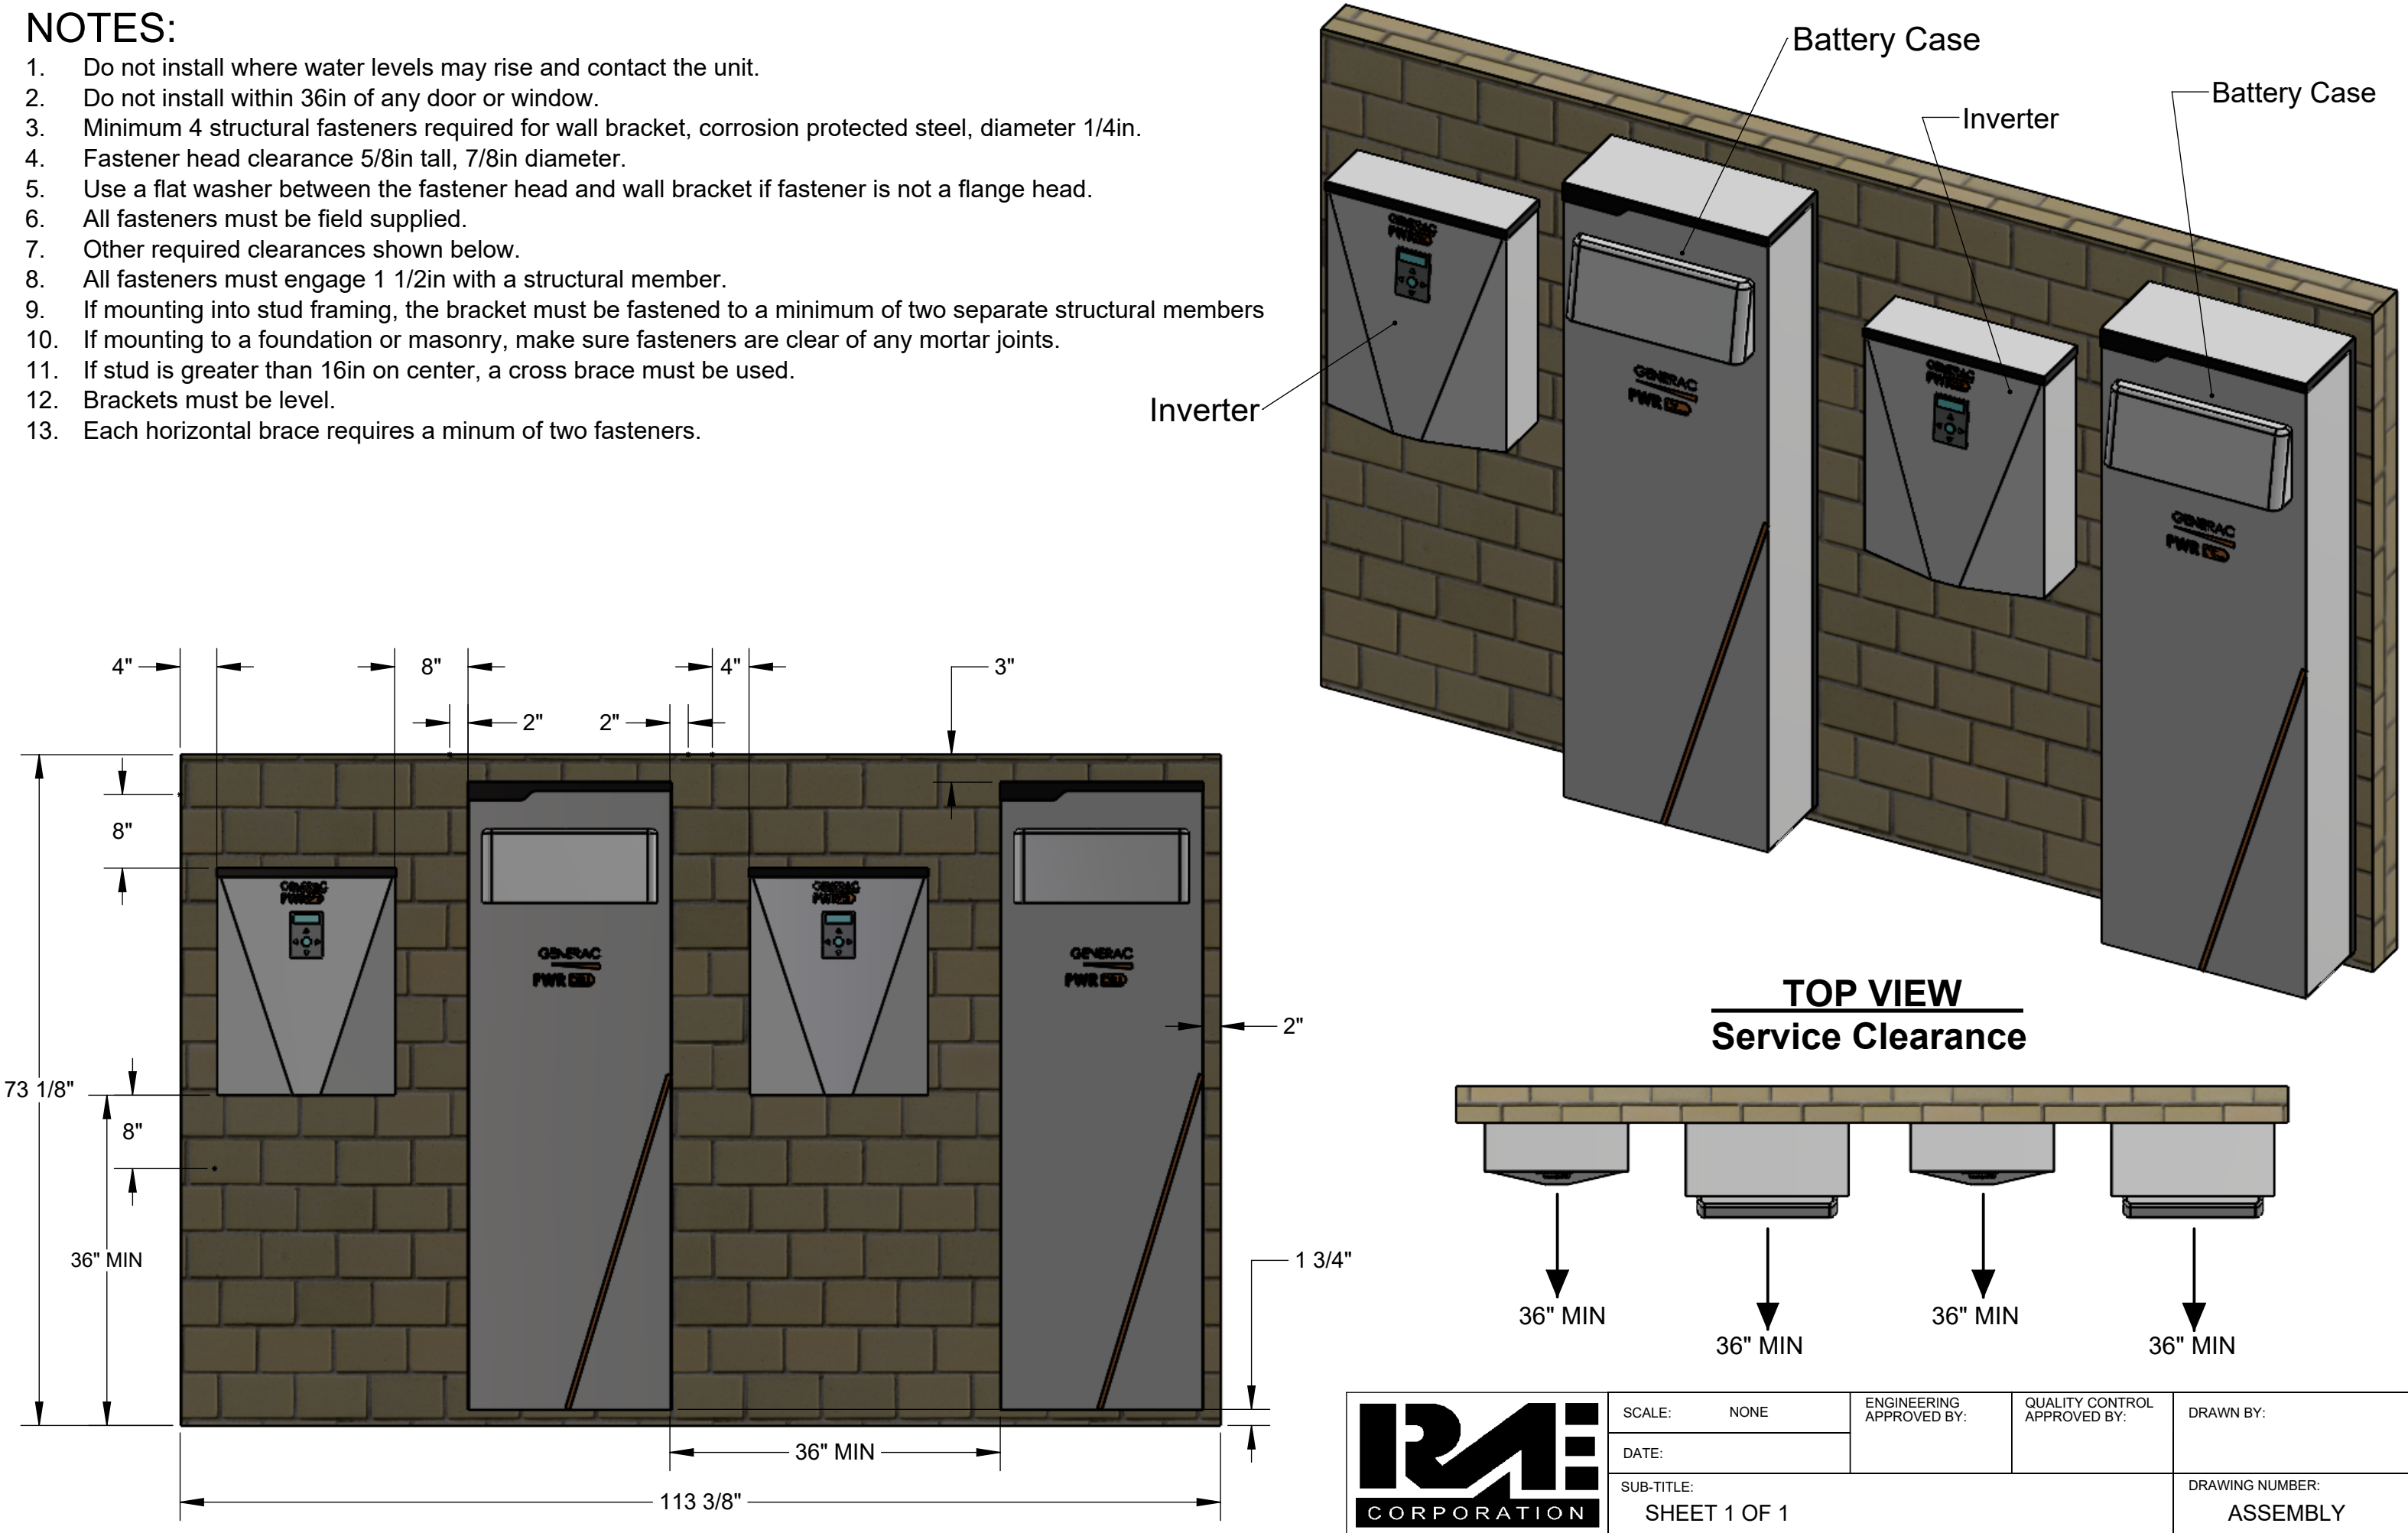

SCALE: NONE	ENGINEERING APPROVED BY:	QUALITY CONTROL APPROVED BY:	DRAWN BY:
DATE:			
SUB-TITLE: SHEET 1 OF 1			DRAWING NUMBER: ASSEMBLY